


WALL MOUNTED (IPSF-5 to IPSF-25)

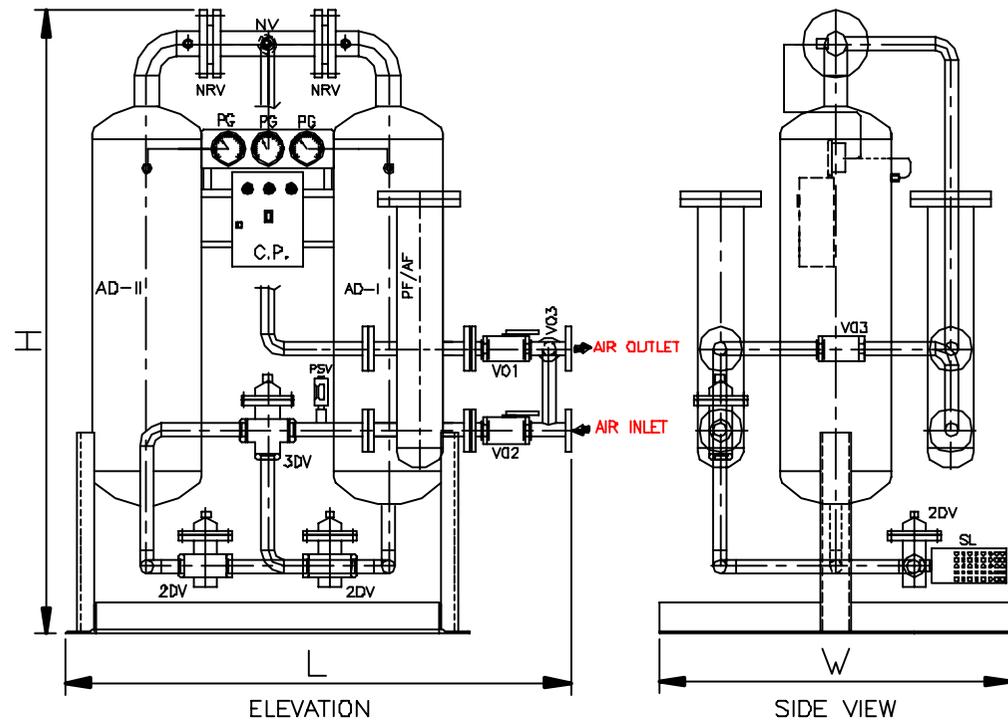

SKID MOUNTED (IPSF-50 to IPSF-1000)

Model	Capacity CFM	L	W	H	Connection In/Out	Weight Kgs	Remark
IPSF-5	5	20	6	28	1/4"BSPT Coup.	25	
IPSF-10	10	20	8	28	1/4"BSPT Coup.	30	
IPSF-15	15	20	8	28	1/4"BSPT Coup.	40	
IPSF-25	25	27.17	8	35	1/2"BSPT Coup.	55	
IPSF-50	50	37	24	63	1/2"ASA150#Flg.	160	
IPSF-100	100	44	28	60	3/4"ASA150#Flg.	195	
IPSF-150	150	40	34	60	1"ASA150#Flg.	275	
IPSF-200	200	45	36	75	1 1/2"ASA150#Flg.	350	
IPSF-250	250	59	42	80	1 1/2"ASA150#Flg.	375	
IPSF-300	300	60	42	80	2"ASA150#Flg.	425	
IPSF-350	350	62	44	85	2"ASA150#Flg.	475	
IPSF-500	500	70	52	106	2"ASA150#Flg.	575	
IPSF-650	650	72	60	90	2"ASA150#Flg.	850	
IPSF-750	750	72	60	95	3"ASA150#Flg.	950	
IPSF-1000	1000	75	65	100	3"ASA150#Flg.	1050	

LEGENDS :

- AD - ADSORBER
- CP - CONTROL PANEL
- NRV - NON RETURN VALVE
- PG - PRESSURE GAUGE
- NV - NEEDLE VALVE
- SV - SOLENOID VALVE
- 2/3DV - 2 & 3 WAY DOME VALVE
- PSV - PRESSURE SAFETY VALVE
- V - BALL VALVE
- PF/AF - PRE / AFTER FILTER
- SL - SILENCER

NOTES :

1. All Dimensions are in "INCHES" unless otherwise specified.
2. All Data Subject to changes without NOTICE.
3. Pls. Consult Factory for larger flow Models
4. Standard reference working conditions of dryer are :
 Inlet air temp : 40°C
 Inlet air pressure. : 7 bar

Model : IPSF-5 to IPSF-1000

PURIFLAIR INDIA PVT. LTD.
 22, GIDC, MAKARPURA, BARODA-10.

DATE	13.01.04		
SIGN.			
	DRN.	CHKD.	APPD.

Std. of IPSF Dryer